


CABLE SIZE	DIMENSION (IN.)			MAX FORCE (LBS.)
	A	C	F	
1/8"	2	1-5/8"	5-1/4"	430
3/16"	2	1-7/8"	5-3/4"	1053
1/4"	2	2-3/8"	6-3/4"	1850
5/16"	2	2-5/8"	7-3/8"	2575

**INSTALLATION INSTRUCTIONS**

- 1.) CABLE RESTRAINTS ARE INSTALLED AFTER EQUIPMENT, PIPE OR DUCT IS IN FINAL OPERATING POSITION. ATTACHMENT IS TO BE MADE TO RESTRAINED OBJECT AND SUPPORTING STRUCTURE AS SHOWN ELSEWHERE IN SUBMITTAL DETAILS.
- 2.) LEAVE CABLE ON SPOOL DURING INSTALLATION.
- 3.) MAKE UP STRUCTURE END OF CABLE BY LOOPING THROUGH BRACKET (FIG.1). ADD CABLE CLIPS AND TIGHTEN CLIPS.
- 4.) MAKE UP EQUIPMENT/PIPE/DUCT END BY PULLING CABLE HAND TIGHT THEN GIVE SLACK BY BACKING OUT 1/8". DO NOT LIFT ANY DEAD WEIGHT.
- 5.) INSTALL CLIPS, CUT CABLE FROM SPOOL.
- 6.) ADJUSTMENT OF CABLES MAY BE NECESSARY DUE TO UNANTICIPATED CHANGES IN OPERATING CONDITIONS.

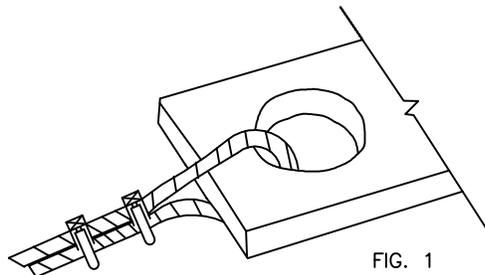

OTHER MATERIALS, COMPOUNDS, OR FINISHES WITH EQUAL OR SUPERIOR PROPERTIES MAY BE SUBSTITUTED AS THEY BECOME AVAILABLE.

**CERTIFIED FOR:**

JOB NAME: \_\_\_\_\_  
 CUSTOMER : \_\_\_\_\_  
 CUSTOMER P.O.: \_\_\_\_\_  
 SALES ORDER: \_\_\_\_\_

**MODEL SEISMIC CABLE  
 CONSTRUCTION FOR  
 NON-ISOLATED PIPE, DUCT,  
 AND EQUIPMENT**



**THE VMC GROUP**  
*The Power of Together*  
 Bloomingdale, NJ 07403  
 Houston, TX 77041

SCALE :

NONE

SHEET:



DRAWING NO.:

REVISION